



DEAS 1151: 2023

ICS 83.083.01

## **DRAFT EAST AFRICAN STANDARD**

---

### **Moulded polyethylene water storage tank — Specification**

**EAST AFRICAN COMMUNITY**

---



### Copyright notice

This EAC document is copyright-protected by EAC. While the reproduction of this document by participants in the EAC standards development process is permitted without prior permission from EAC, neither this document nor any extract from it may be reproduced, stored or transmitted in any form for any other purpose without prior written permission from EAC.

Requests for permission to reproduce this document for the purpose of selling it should be addressed as shown below or to EAC's member body in the country of the requester:

© East African Community 2023 — All rights reserved  
East African Community  
P.O. Box 1096,  
Arusha  
Tanzania  
Tel: + 255 27 2162100  
Fax: + 255 27 2162190  
E-mail: [eac@eachq.org](mailto:eac@eachq.org)  
Web: [www.eac-quality.net](http://www.eac-quality.net)

Reproduction for sales purposes may be subject to royalty payments or a licensing agreement. Violators may be prosecuted.

# Contents

Page

Foreword .....	v
1 Scope .....	1
2 Normative references .....	1
3 Terms and definitions .....	1
4 Types .....	4
5 Requirements .....	4
5.1 General requirements .....	4
5.2 Materials .....	5
5.3 Carbon black content .....	5
5.4 Catalyst .....	5
5.5 Fillers and pigments .....	6
5.6 Fittings .....	6
5.7 Sizes .....	6
5.8 Net capacity (actual) .....	6
5.9 Design requirements .....	6
5.9.1 Cylinder shell (unsupported portion of tanks) .....	6
5.9.2 Cylinder shell (externally supported tanks) .....	6
5.9.3 Top head .....	6
5.9.4 Bottom head .....	6
5.9.5 Open-top tanks .....	7
5.10 Dimensions and tolerances .....	7
5.10.1 General .....	7
5.10.2 Outside diameter .....	8
5.10.3 Shell wall and head thickness .....	8
5.10.4 Placement of fittings .....	8
5.11 Mechanical properties .....	8
6 Finish .....	8
7 Test methods .....	9
7.1 Resistance to deformation test .....	9
7.2 Flexural strength test .....	9
7.3 Test for top load resistance .....	9
7.4 Hydrostatic pressure head test .....	9
8 Sampling .....	9
8.1 Lot .....	9
8.2 Routine tests .....	10
9 Marking and labelling .....	10
Annex A (normative) Determination of carbon black content .....	11
A.1 Apparatus .....	11
A.2 Reagents .....	11
A.3 Procedure .....	11
A.4 Calculation .....	12
Annex B (informative) Determination of effect of heavy metals on water quality .....	13
B.1 Test specimen .....	13
B.2 Method of extraction .....	13
B.3 Method of analysis .....	13
Annex C (informative) Deformation test .....	14

C.1	Method 1 (for cylindrical vertical tank).....	14
C.2	Method 2 (for rectangular loft tank) .....	14
	Bibliography .....	16

DRAFT EAST AFRICAN STANDARD FOR PUBLIC REVIEW

## Foreword

Development of the East African Standards has been necessitated by the need for harmonizing requirements governing quality of products and services in the East African Community. It is envisaged that through harmonized standardization, trade barriers that are encountered when goods and services are exchanged within the Community will be removed.

The Community has established an East African Standards Committee (EASC) mandated to develop and issue East African Standards (EAS). The Committee is composed of representatives of the National Standards Bodies in Partner States, together with the representatives from the public and private sector organizations in the community.

East African Standards are developed through Technical Committees that are representative of key stakeholders including government, academia, consumer groups, private sector and other interested parties. Draft East African Standards are circulated to stakeholders through the National Standards Bodies in the Partner States. The comments received are discussed and incorporated before finalization of standards, in accordance with the Principles and procedures for development of East African Standards.

East African Standards are subject to review, to keep pace with technological advances. Users of the East African Standards are therefore expected to ensure that they always have the latest versions of the standards they are implementing.

The committee responsible for this document is Technical Committee EASC/TC 072, *Plastics and related products*

Attention is drawn to the possibility that some of the elements of this document may be subject of patent rights. EAC shall not be held responsible for identifying any or all such patent rights.



# Moulded polyethylene water storage tank — Specification

## 1 Scope

This Draft East African Standard specifies requirements, sampling and test methods for rotational moulded and blow moulded polyethylene water storage tanks (closed and open top tank).

This standard is not applicable to underground tanks, mobile water tanks and horizontal cylindrical water tanks.

## 2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 1133-1, *Plastics — Determination of the melt mass-flow rate (MFR) and melt volume-flow rate (MVR) of thermoplastics — Part 1: Standard method*

ISO 1183-1, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method*

ISO 4892-2, *Plastics — Methods of exposure to laboratory light sources — Part 2: Xenon-arc lamps*

ISO 13274, *Packaging — Transport packaging for dangerous goods — Plastics compatibility testing for packaging and IBCs*

ISO 18872, *Plastics — Determination of tensile properties at high strain rates*

ISO 23900-3, *Pigments and extenders — Methods of dispersion and assessment of dispersibility in plastics — Part 3: Determination of colouristic properties and ease of dispersion of black and colour pigments in polyethylene by two-roll milling*

US ISO 1209-1, *Rigid cellular plastics — Determination of flexural properties — Part 1: Basic bending test*

US ISO 1209-2, *Rigid cellular plastics — Determination of flexural properties — Part 2: Determination of flexural strength and apparent flexural modulus of elasticity*

## 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at <http://www.iso.org/obp>

**3.1 net capacity (actual)**  
net total volume of water contained between the lowest level of the overflow and lowest level of outlet (see Figure 1 and Figure 2)

**3.2 gross capacity/nominal capacity**  
total enclosed volume of the tank including any space

Note 1 to entry: The space may not be capable of being filled with water.

**3.3 mould parting line**  
circumferential line visible only on the external surface of the tank corresponding to a parting joint of the mould required for rotational moulding (see Figure 1 and Figure 2)

**3.4 overall height**  
height of the finished empty tank at its highest point, including the top rim of the manhole and lid of the tank (see Figure 1 and Figure 2)

**3.5 effective height**  
height of the finished empty tank from its base to the point where overflow connection is provided for the purpose of limiting water storage capacity (see Figure 1 and Figure 2)

**3.6 overall diameter**  
maximum outer diameter of the finished empty tank measured at its base (see Figure 1 and Figure 2)

**3.7 manhole/handhold hole**  
hole of suitable internal diameter provided at the top of the tank for the purpose of inspection of internal surface and entry into the tank (see Figure 1)

**3.8 internal diameter of manhole/hand-hole**  
internal diameter of the rim of the manhole measured as the mean of two perpendicular diameters (see Figure 1 and Figure 2)

**3.9 closed tank**  
tank moulded as a single piece with the top as an integral part (see Figure 1)


**3.10 open top tank**  
tank where the body and top are moulded separately and assembled after moulding (see Figure 2)

**3.11 rotational moulding**  
commercial process consisting of loading the mould with powdered resin, fusing the resin by heating while rotating the mould about more than one axis, and cooling and removing the moulded article

**3.12 blow moulding**  
method of forming hollow objects by inflating a parison into a mould with compressed air


**3.13  
elongation**

increase in distance between references likes on the narrow parallel portion of the test specimen, due to a tensile load, and expressed as a percentage of the initial distance between the reference lines

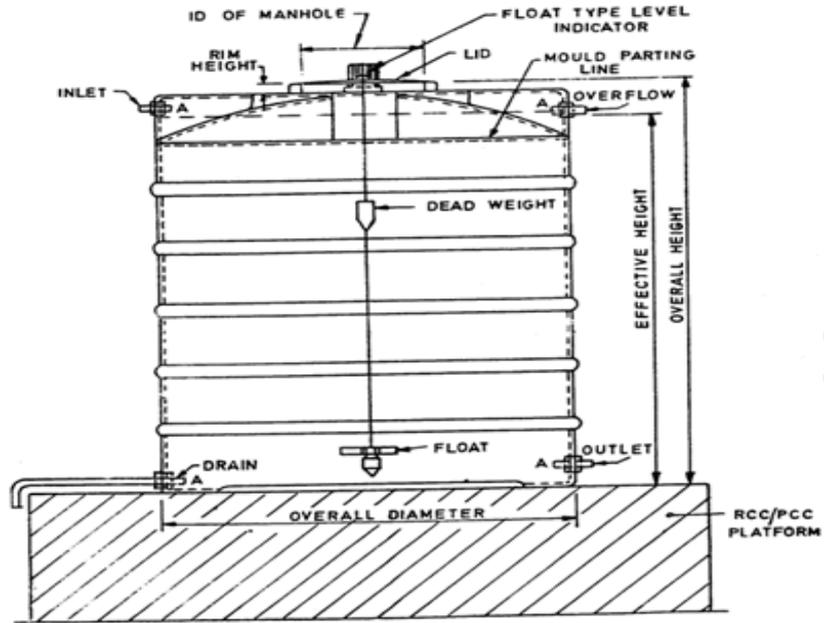

- Key**  
**RCC** Reinforcement  
**PCC** Pre-cast cement concrete

**Figure 1 — Typical view of closed top tank**

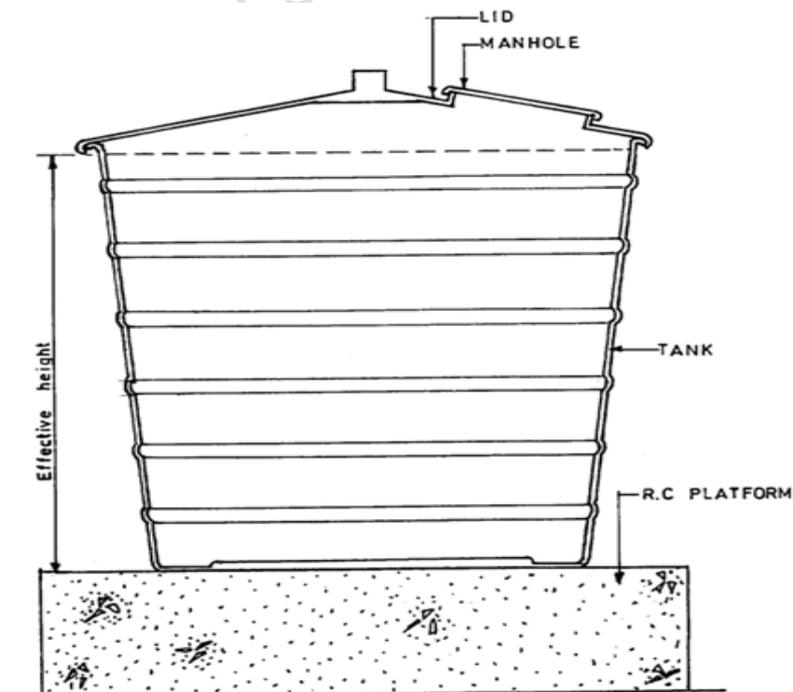

**Figure 2— Typical view of open top tank**

## 4 Types

There shall be two types of tanks namely:

- a) cylindrical vertical tanks (closed and open-end); and
- b) rectangular loft tanks [see Figure 3 a) and b)].

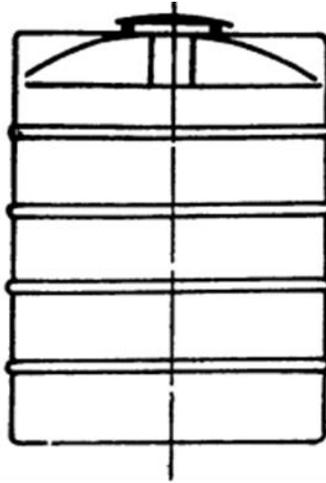


Figure 3a) — Cylindrical vertical with closed top

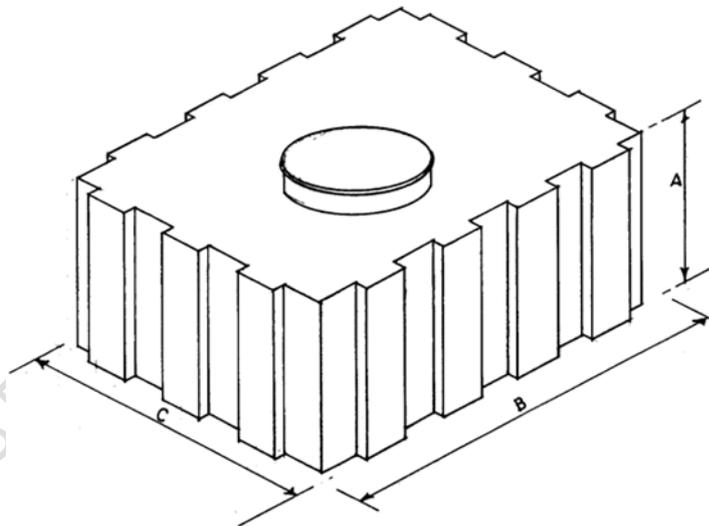


Figure 3 b) — Rectangular loft tank

## 5 Requirements

### 5.1 General requirements

5.1.1 The following conditions apply to both open-top and closed-top water storage tanks:

- a) own hydrostatic head of water; and
- b) uniform flat base support;

5.1.2 The nominal service temperature shall be 1 °C — 50 °C.

5.1.3 The lid of the tank shall fit securely over the top rim of the tank, and it shall rest evenly on it in order to prevent the ingress of foreign matter through the top of the tank. The lid shall be provided with a suitable closing system.

## 5.2 Materials

5.2.1 The materials for construction of the tank and lid that come into contact with water shall be of food grade. The tank shall meet the material requirements given in Table 1.

**Table 1 — Requirements for materials**

5.2.2 Water tanks meant for outdoor use shall be manufactured from virgin polyethylene materials. The

Material type	Property		Requirement	Test method
Blow-moulded polyethylene and rotationally moulded polyethylene	Density <sup>a</sup> , kg/m <sup>3</sup> , min.		930	ISO 1183-1
	Melt flow rate <sup>b</sup> at 190 °C and 2.16 kg		4.0 g/10 min ± 3.0 g/10 min	ISO 1133-1
	Tensile strength <sup>c</sup>	At yield, MPa, min.	12	ISO 18872
	Elongation	Elongation at yield, %, max.	25	
		Elongation at break, %, min.	200	
<p>a Test to be carried out on raw material</p> <p>b Test to be carried out on raw material and on tank.</p> <p>c Test to be carried out on tank.</p> <p>d Maximum increase of the melt flow rate of the moulded tank shall not be greater than 15 % of the value determined on the raw material</p>				

outer layer of the tank, however, shall be made from virgin and 10 % maximum recycled material. The inside layer shall be made of 100 % virgin material.

5.2.3 All polyethylene resin materials shall contain UV stabilizer as compounded by the resin manufacturer or compounded by the tank manufacturer, which is applicable to the layer that is exposed to the sun.

5.2.4 The material for construction of the tank and lid, which comes into contact with water, shall not impart any taste, colour or odour to water; they shall neither have any toxic effect nor contaminate water thereby making it unpotable.

## 5.3 Carbon black content

5.3.1 For tanks intended to be used outdoors, carbon black pigment shall be added to the moulding material for the outer layer or the exposed layer and shall be 2.5 % ± 0.5 % when tested in accordance with Annex A.

5.3.2 The carbon black or any other pigment added shall be uniformly dispersed in the material, when tested in accordance with Method A of ISO 23900-3.

## 5.4 Heavy metals

The total amount of inorganic material present in polyethylene shall not exceed 0.2 % (m/m) when tested by the Atomic Absorption Method and in accordance with Annex B. An alternative method of testing for the

metals shall be by X-ray fluorescence, where the Atomic Absorption Method may not be applicable or just non-operational.

## 5.5 Fillers and pigments

The plastic shall not contain any filler. Pigments may be added as desired by the customer, or as designated by polymer processing companies, but shall not exceed 0.5 % dry blended, and 2 % compounded in, of the total weight.

## 5.6 Fittings

It shall be the prerogative of the manufacturer to provide as much information as is possible to the consumer regarding fittings.

## 5.7 Sizes

Tank sizes will vary in accordance with the customer's requirements and shall be as given in 5.10.

## 5.8 Net capacity (actual)

**net total volume of water contained between the lowest level of the overflow and lowest level of outlet**

## 5.9 Design requirements

### 5.9.1 Cylinder shell (unsupported portion of tanks)

5.9.1.1 The minimum wall thicknesses of the tanks shall be as given in Table 2 and Table 4.

5.9.1.2 The hydrostatic design stress that is used to determine the minimum wall thickness at any fluid level shall be based on hoop stress data for the polyethylene materials. The hydrostatic design-basis shall be reduced by a service factor to determine the actual hydrostatic design stress. The maximum service factor shall be 0.5 for wall thicknesses less than 9.5 mm. For thicknesses equal to or greater than 9.5 mm, the maximum service factor shall be 0.475.

5.9.1.3 Tank hoop stresses shall be derated for service above 23 °C.

### 5.9.2 Cylinder shell (externally supported tanks)

The minimum required wall thickness for the cylinder straight shell shall be sufficient to support its own weight in an upright position without any external support. The tolerance indicated in 5.10.3 applies to these dimensions.

### 5.9.3 Top head

The top head shall be integrally moulded with the cylinder shell. The minimum thickness of the top head shall be equal to the top of the straight wall.

### 5.9.4 Bottom head

The bottom head shall be integrally moulded with the cylinder shell. The radius of the bottom knuckle of a flat bottom tank shall not be less than 25.4 mm for tanks with a diameter less than 1.8 m, and 38.1 mm for a diameter greater than 1.8 m. The minimum thickness of the radius shall not be less than the maximum thickness of the cylinder wall.

### 5.9.5 Open-top tanks

The top edge of open tanks shall be reinforced by design to maintain its shape after installation.

## 5.10 Dimensions and tolerances

### 5.10.1 General

All dimensions shall be taken, with the tank in the vertical position, unfilled. Tank dimensions shall represent the exterior measurements. The thickness shall be as specified in Table 2 for rotational moulded tanks and Table 4 for blow-moulded tanks.

**Table 2 — Dimensions for rotational moulded cylindrical vertical tank**

Volume L	Minimum thickness mm	
100 and below	2.3	
150	2.5	
250	2.7	
500	2.8	
750	3.0	
1 000	3.7	
1 500	3.8	
2 000	4.0	
2 500	4.1	
3 000	4.2	
4 000	4.5	
5 000	4.8	
6 000	5.0	
8 000	6.0	
10 000	10.0	

**Note:** Any other tank capacities whose requirements are not included in the above table shall be as per the agreement between the end user and the manufacturer. However, the tank thickness shall be expressed from interpolation/extrapolation of the values provided in the Table 2 in accordance with Annex D.

**Table 3 — Recommended dimensions for rotational moulded rectangular loft tanks**

400	2.75
500 and above	> 2.75

**Table 3 — Recommended dimensions for blow-moulded cylindrical vertical tank**

Volume L	Minimum thickness mm			
	Top wall	Side wall	Bottom wall	
250	1.6	2.0	2.2	
500	2.0	2.1	2.3	
1 000	2.2	2.5	2.8	
1 500	2.3	2.8	3.2	
2 000	2.6	3.0	3.8	
2 500	2.8	3.0	4.0	
3 000	3.1	3.4	4.3	
4 000	3.5	3.7	5.3	
5 000	3.5	3.9	5.5	
8 000	3.5	4.0	5.8	
10 000	4.5	5.0	5.8	

**Note:** Any other tank capacities whose requirements are not included in the above table shall be as per the agreement between the end user and the manufacturer. However, the tank thickness shall be expressed from interpolation/extrapolation of the values provided in the Table 3 in accordance with Annex D.

### 5.10.2 Outside diameter

The tolerance for the outside diameter, including out of roundness, shall be  $\pm 3\%$ .

### 5.10.3 Shell wall and head thickness

The tolerance for average thickness at each elevation shall be  $-10\%$  of the design thickness on the low side and shall be unlimited on the high side. The tolerance for individual audit readings shall be limited to  $-20\%$  of the design thickness. The total amount of surface area on the low side of the tolerance shall not exceed  $10\%$  of the total surface area.

## 5.11 Mechanical properties

**5.11.1** The flexural modulus of the wall of the water tank shall not be less than  $400 \text{ N/mm}^2$  when determined in accordance with ISO 1209-1 and ISO 1209-2.

**5.11.2** When the cylindrical vertical water storage tank is tested in accordance with Method 1, in Annex C, the difference between the circumferential measurements shall not be greater than  $2\%$  of the original measurements.

## 6 Finish

**6.1** The internal surface of the water storage tank shall be smooth to the extent that nothing sticks to it, and easily cleanable, clean and free from other hidden internal defects, such as air bubbles, pits and metallic or other material inclusions.

**6.2** The mould parting line near the top rim of the tank shall be cut and finished to the required level. Defects like air bubbles and pits at the parting line and at the top of the manhole shall be repaired.

**6.3** The finished tank wall shall be free, as commercially practicable, of visual defects such as foreign inclusions, air bubbles, pinholes, pimples, crazing, cracking and delamination that will impair the serviceability of the tank.

**6.4** All cut edges where openings are cut into the tanks shall be trimmed, smooth.

## **7 Test methods**

### **7.1 Resistance to deformation test**

**7.1.1** The resistance to deformation test shall be determined in accordance with Method 1 of Annex C.

**7.1.2** When a rectangular loft tank is tested in accordance with Method 2 of Annex C, the difference between the longitudinal measurements shall not be greater than 3 % of the original measurements.

### **7.2 Flexural strength test**

The flexural modulus of the wall of the water tank shall be determined in accordance with ISO 1209-1 and ISO 1209-2.

### **7.3 Test for top load resistance**

The tank shall be filled to 98 % of its net capacity and shall be subjected for not less than 4 h at outdoor temperature to compression by means of 100-kg load applied on the horizontal surface, provided for a man to stand before entering the tank. After removal of the load, the test specimen shall be inspected for deformation or crack on the surface and after 4 h of the removal of the load, the flat surface shall return to normal position. This test shall be applied to tanks with capacity of 3 000 L and more.

### **7.4 Leakage test**

**The tank shall be filled with water to its maximum capacity, it shall remain for a period of two weeks. it shall observe no signs of leakage. a leak test will be conducted if requested by the customer**

## **8 Sampling**

### **8.1 Lot**

**8.1.1** All the water storage tanks of same raw material, same type, size and produced under relatively uniform conditions of manufacture shall constitute a lot.

**8.1.2** The sample size shall be determined in accordance with Table.

**Table 5 — Scale of sampling and criteria for conformity of tanks**

<b>Lot size</b>	<b>Sample size</b>	<b>Maximum possible failure</b>
Up to 50	1	0
200	2	0

300	3	0
500	5	0
501 and above	8	1

**8.1.3** Tanks shall be selected at random from the lot. In order to ensure randomness of selection, tables of random numbers shall be used.

**8.1.4** Each tank selected in accordance with Table 5 shall be tested for the requirements in Table 6.

**Table 6 – Routine test parameters**

Test	Test method
Resistance to deformation	7.1
Carbon black content	Annex A
Carbon black dispersion	ISO 23900-3

## 8.2 Routine tests

The routine tests listed in Table 6 shall be carried out to ensure that satisfactory quality is maintained during a production run.

## 9 Marking and labelling

**9.1** Plastic water storage tanks shall be marked legibly and indelibly in English and/or any other official language (French, Kiswahili, etc.) used in the importing East African Partner State with the following information with the:

- a) manufacturer's name or trade mark;
- b) net capacity in litres;
- c) country of origin; and
- d) code of resin identification and symbol for recycling in accordance with EAS 1086.

**9.2** Plastic water storage tanks shall be labelled legibly and indelibly in English and/or any other official language (French, Kiswahili, etc.) used in the importing East African Partner State with the following information with the:

- a) name of product as, "plastic tank";
- b) name and physical address of manufacturer;
- c) lot number and/or batch number; and
- d) manufacture date.

## Annex A (normative)

### Determination of carbon black content

#### A.1 Apparatus

**A.1.1 Combustion boat**, made of porcelain or silica, having minimum dimensions of 15 mm length, 9 mm width and 8 mm height

**A.1.2 Combustion tube**, made of hard glass of approximately 30 mm diameter and 400 mm ± 50 mm length

**A.1.3 Gas flow meter**, for measuring and controlling the rate of flow of nitrogen within 1.7 L/s ± 0.3 L/s

**A.1.4 Thermometer**, in the range of 250 °C - 550 °C

**A.1.5 Furnace**, to accommodate the combustion tube to give temperatures up to at least 500 °C

#### A.2 Reagents

**A.2.1** Nitrogen, as technical grade

**A.2.2** Trichloroethylene

#### A.3 Procedure

**A.3.1** Assemble the apparatus as shown in Figure A.1. Both cold traps following the combustion tube shall contain trichloroethylene, but only the first needs be cooled with solid carbon dioxide. Alternatively, the entire apparatus may be placed in a fume hood and the two traps following the combustion tube omitted. Fill the dry tube with anhydrous  $\text{CaCl}_2$  or other suitable desiccant. Hold between loose plugs of glass wool.

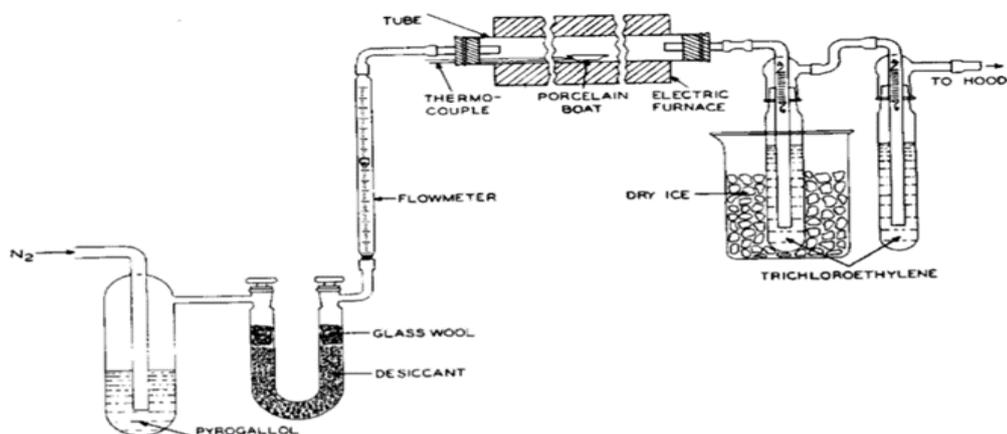


Figure A.1 – Assembly of apparatus for carbon black determination

**A.3.2** Heat a clean combustion boat to red hot in a Bunsen flame; transfer the boat to the desiccant and allow it to cool over fresh desiccant. Hold between loose plugs of glass wool.

**A.3.3** Remove the boat from the desiccant and weigh it to the nearest 0.000 1 g. Immediately place 1.0 g ± 0.1 g of the ethylene plastic under test in the boat and quickly weigh to the nearest 0.000 1 g.

**A.3.4** Heat the furnace to a constant temperature of 600 °C. Adjust the rate of nitrogen flow to 1.7 L/min ± 0.3 L/min. Open the inlet end of the 2.9-cm diameter tube, quickly place the combustion boat with the sample into the tube at the centre of the furnace, and adjust the thermocouple so that the weld is touching the boat. Insert a copper plug, if this is used. Quickly close the furnace and allow heating to proceed for at least 15 min.

**A.3.5** Move the tube or furnace so that the boat is no longer in the heated zone of the furnace and allow 5 min for cooling, while maintaining the flow of nitrogen. Remove the copper plug, if present and the boat through the inlet end of the tube and allow it to cool for at least 30 min. Take care that the boat does not become contaminated from any deposits on the walls of the tube. Then quickly reweigh the boat and its contents to the nearest 0.000 1 g.

**A.3.6** Make all determinations in duplicate.

#### **A.4 Calculation**

The carbon black content, expressed as a percentage, shall be calculated using the formula below:

$$W = \frac{W_r}{W_s} \times 100$$

where

$W$  is carbon black content, by percent weight;

$W_r$  is the mass, in grams, of the boat before heating in air;

$W_s$  is the mass, in grams, of the boat after heating in air.

## **Annex B** (informative)

### **Determination of effect of heavy metals on water quality**

#### **B.1 Test specimen**

Three test specimens of approximately 500 mm<sup>2</sup> in surface area shall be taken from the tank.

#### **B.2 Method of extraction**

**B.2.1** Each test specimen shall be pre-washed for a period of 6 h using tap water with pH of 7 to 8. The water shall be passed through the specimen at a velocity of 50 mm/s while the specimen is kept fully immersed in water. After washing, the specimen shall be filled with fresh solution of the distilled water acidified to pH of  $4.5 \pm 0.1$  by bubbling a current of carbon dioxide through it, and both ends sealed with a material that does not contain any toxic substances or interfere with the determinations of such constituents in the aqueous samples.

**B.2.2** After maintaining the specimens at room temperature for 48 h, the solution shall be decanted into a suitable container for analysis as the first extraction.

**B.2.3** The procedure shall be repeated a second and a third time. Retain these samples for the determination of the amount of metals and other toxic substances as second and third extractions.

**B.2.4** The first extraction and the third extraction shall be analysed for lead. The third extraction shall also be analysed for dialkyl tin as tin.

**B.2.5** When calcium and mercury are present, all three extracts shall be analysed.

#### **B.3 Method of analysis**

Analysis for lead, tin, cadmium and mercury shall be carried out using atomic absorption.

## Annex C (informative)

### Deformation test

#### C.1 Method 1 (for cylindrical vertical tank)

**C.1.1** The water tank shall be placed on a flat level base. A circumferential measurement shall be made parallel to the base at a distance of one third, the effective height from the bottom. The tank shall be filled up to the effective height at a minimum rate of 23 L/min with water at a temperature of not less than 15 °C.

**C.1.2** A continuous film of polyethylene shall be floated over the whole of the surface of water in tank to prevent evaporation.

**C.1.3** The temperature of the tank and water shall be maintained at a temperature not less than 15 °C and after seven days, a circumferential measurement shall be made at a level referred to in C.1.1. The difference between the two circumferential measurements shall be expressed as a percentage of the original circumferential measurement.

#### C.2 Method 2 (for rectangular loft tank)

**C.2.1** The rectangular tank shall be placed on a level base. The internal length and width of the tank shall be measured on the centrelines, as shown in Figure C.1, at the centre of effective height.

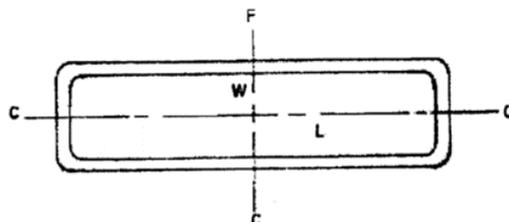


Figure C.1 — Centreline measure

**C.2.2** The tank shall be filled up to the effective height at a minimum rate of 23 L/min with water at a temperature not less than 15 °C. The lid shall close after filling the loft tank.

**C.2.3** The temperature of the tank and water shall be maintained at not less than 15 °C and after seven days, measurements of length and width shall be made at previously determined centrelines.

**C.2.4** The deformation in each direction, expressed as a percentage, shall be calculated using the formula below

$$D_w = \frac{L_2 - L_1}{2W_1} \times 100$$

$D_w$  is the deformation, in percentage, for the shorter side;

$L_2$  is the length, in millimetres, of the tank at the end of test;

$L_1$  is the length, in millimetres, of the tank at the start of the test; and

$W_1$  is the width, in millimetres, of the tank at the start of the test.

DRAFT EAST AFRICAN STANDARD FOR PUBLIC REVIEW

Annex D  
(informative)

### A guideline for Interpolation of Minimum Wall thickness

This a guideline for determining the minimum wall thickness for volumes of tanks that are not in the table given in the standards.

The principle is linear interpolation: a mathematical technique used to estimate an unknown value within a range of known data points. It assumes that the change between two consecutive points is linear and uses that assumption to calculate intermediate values.

#### Formula for Linear Interpolation

For two known points (X1, Y1) and (X2, Y2), the interpolated value Y at a given point X, where (X1 ≤ X ≤ X2) is calculated as follows:

$$Y = y_1 + \frac{(X - X_1)}{(X_2 - X_1)} * (y_2 - y_1)$$

#### Explanation of the Formula

1. (x1,y1) and (x2,y2) are the coordinates of the two known values.
2. x is the target value within the interval [x1,x2].
3. The term (x-x1)/(x2-x1) calculates the relative position of x between x1 and x2.
4. The result is scaled by the change in y (y2-y1) to determine the corresponding change in y for the given x.

#### Example

Take an Example from the table provided of 2 sizes with their wall thickness, 100L with thickness of 2.3mm and 150L with 2.5mm, while targeting the thickness for 140L which is a size between 100L & 150L.

**Following the above formula,**

$$T = 2.3 + \frac{(140-100)}{(150-100)} * (2.5-2.3) = 2.46$$

Therefore, the minimum wall thickness for a 140L tank as interpolated from the given table is 2.46mm.

DRAFT EAST AFRICAN STANDARD FOR PUBLIC REVIEW

## Bibliography

- [1] RS 128: 2019, *Rotational moulded polyethylene water storage tanks — Specification*
- [2] TZS 892-1: 2019, *Polyethylene tanks for storage of potable water — Part 1: Specifications*
- [3] US 1560: 2022, *Moulded polyethylene water storage tank — Specification*
- [4] IS 12701(1996): *Rotational moulded polyethylene water storage tanks.*

DRAFT EAST AFRICAN STANDARD FOR PUBLIC REVIEW

DRAFT EAST AFRICAN STANDARD FOR PUBLIC REVIEW